

MECHANICAL VAPOR COMPRESSION DISTILLATION

B. Tleimat

Water Re-use Technology, Alamo, California, USA

Keywords : Compressors, Vapor Compression, Salinity, Centrifugal Compressors

Contents

1. Process Description
 2. Process Analysis
 3. Effects of Salinity and Temperature on Energy Consumption
 4. System Heat Balance
 5. Heat Transfer Surface Requirement
 6. Effects of Evaporator Temperature on Heat Transfer Area
 7. Effects of Evaporator Type on Energy
 8. Multieffect Vapor Compression Distillation
 9. Comparison of Single-effect and Multieffect Vapor Compression Distillation Systems
 10. Forced Circulation Vapor Compression
 11. Compressors
 12. Comparison of Lobe-type and Centrifugal Compressors
- Appendix
Glossary
Bibliography and Suggestions for further study

1. Process Description

Mechanical vapor compression distillation of saline water is a process in which mechanical energy is used as the main driving force. It is basically a heat pump process that pumps heat from a low-temperature reservoir to a higher temperature reservoir, just as in household refrigerators where the heat is pumped from the air inside the refrigerator box to the ambient air outside of the box. The main elements consist of an evaporator, a condenser, a compressor, and an expansion valve where refrigerants such as Freon or ammonia are used as working fluid in a closed cycle. The coils inside the refrigerator box form the evaporator and the coils outside the box form the condenser. Here the working fluid inside the coils in the evaporator, evaporates to absorb heat from inside the box, compressed to raise its saturation pressure and temperature and then enters the condenser coils outside the box to release its latent heat of condensation to the ambient air. The high-pressure liquid refrigerant then enters the expansion valve where it flashes down to the evaporator pressure to complete the cycle.

In a vapor compression distillation of saline water, the system is not a closed cycle and the basic system consists of the evaporator-condenser and the compressor. The working fluid is water vapor. Water vapor generated from the water layer on the evaporation side of the heat transfer surface is compressed to raise its saturation temperature and pressure and is then condensed on the condensation side of the heat transfer surface, forming

then cooled to state point 8 in the three-stream exchanger.

2. Process Analysis

Figure 2 shows the temperature entropy diagram corresponding to the flow diagram shown in Figure 1. Here T_5 and T_7 represent, respectively, the absolute temperature in the evaporation and condensation sides of the evaporator. Due to the presence of dissolved salts in the brine, the vapor pressure in the evaporator p_e is lower than the vapor pressure p_{se} of pure water corresponding to T_5 . Because the vapor generated is in equilibrium with the brine at T_4 , it is slightly superheated by an amount α the boiling point elevation. Friction losses in the piping from state point 4 to state point a cause a pressure drop $p_e - p_i$ with a very slight decrease of temperature due to isenthalpic flow of the vapor from state point 4 to a.

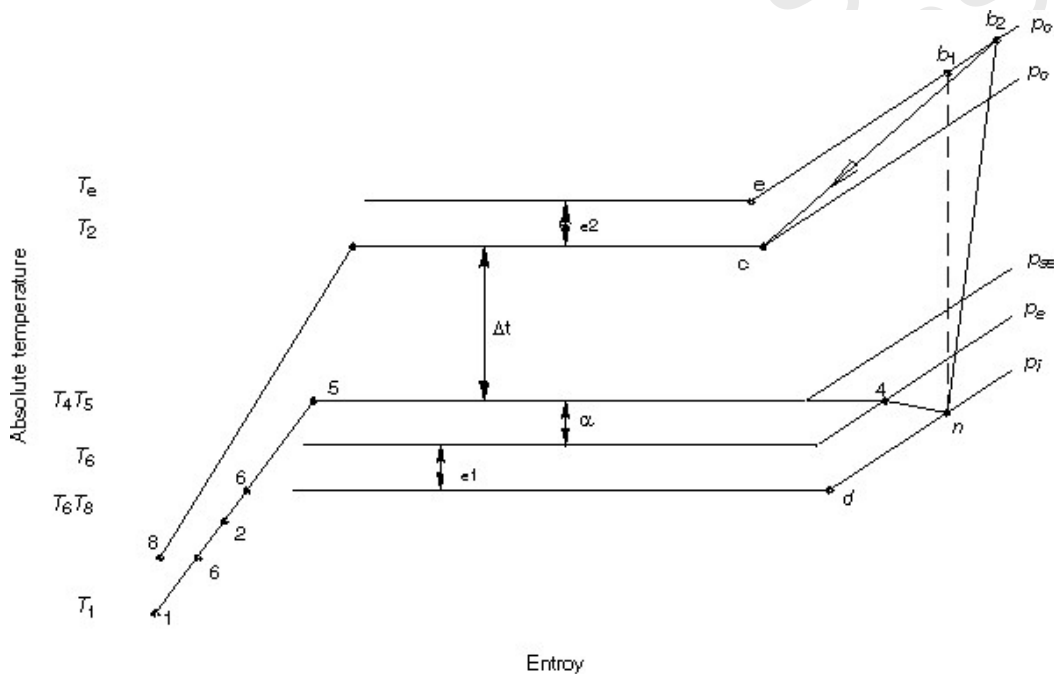


Figure 2. Temperature-Entropy diagram for the single-effect, multieffect vapor compression distillation system.

In the compressor, the vapor is compressed adiabatically from state point a at the inlet pressure p_i to state point b at the outlet pressure p_0 and then enters the condensation side of the evaporator where it condenses on heat transfer surface A at pressure p_c (slightly lower than p_0 , due to friction losses in the outlet piping). The condensate is taken out at state point 7 to be cooled to state point 8 in the three-stream heat exchanger.

The total pressure rise, $p_0 - p_i$, supplied by the compressor consists of the following segments.

- (a) $p_e - p_i$ pressure rise to overcome ϵ_1 , the friction losses in inlet piping.

- (b) $p_{se} - p_e$ pressure rise to overcome the boiling point elevation.
 (c) $p_c - p_{se}$ pressure rise to overcome Δt .
 (d) $p_0 - p_c$ pressure rise to overcome ε_2 , the friction losses in outlet piping.

The energy imparted to the vapor during compression from a to b is given by the difference of enthalpies between state points b and a. For a well-insulated compressor, the specific energy input to the vapor w_c by the compressor is

$$w_c = h_b - h_a = \int Tds + \int vdp \quad (1)$$

where Tds and vdp are integrated from state point a to state point b. For an ideal compressor, the pressure rise across the compressor would be represented by the isentropic line ab_1 . The isentropic work ($ds = 0$) is then given by

$$w_{ci} = h_{b1} - h_a = \int vdp \quad (2)$$

where vdp is integrated from state point a to state point b_1 . For most applications using vapor compression distillation in the temperature range of 100°C or lower, water vapor can be assumed to behave as an ideal gas. Using this assumption, the integral $\int vdp$ can be evaluated using the relation $pv^\kappa = \text{constant}$. This assumption results in

$$w_{ci} = \kappa RT_a \left[\left(p_o / p_i \right)^{\frac{(\kappa-1)}{\kappa}} - 1 \right] / (\kappa - 1) \quad (3)$$

The Clapeyron equation relates the absolute pressure and absolute temperature along the saturation line by the following equation:

$$dp / p = \lambda_f dT / RT^2 \quad (4)$$

Assuming λ_f to be constant in this range and integrating the equation from state point d to state point e (Figure 2) results in

$$\ln(p_o / p_i) = \lambda_f (T_e - T_3) / RT_e T_3 \quad (5)$$

as $T_e = T_4 + \Delta t + \varepsilon_2$ and $T_3 = T_4 - \alpha - \varepsilon_1$ and as Δt , ε_1 , ε_2 , and α are small in comparison to T_4 , one can make the following approximation:

$$T_e T_3 = (T_4 + \Delta t + \varepsilon_2)(T_4 - \alpha - \varepsilon_1) \cong T_4^2$$

and as $T_a \cong T_4$, Eq. (5) can be written as

$$\ln(p_o / p_i) \cong \lambda_f (\varepsilon_2 + \Delta t + \alpha + \varepsilon_1) / RT_4^2 \quad (6)$$

Substituting Eq. (6) into Eq. (3) and observing that $\kappa R/(\kappa-1) = c_p$ for ideal gas we obtain

$$w_{ci} = c_p T_4 [\exp\{\lambda_f (\Delta t + \alpha + \varepsilon_1 + \varepsilon_2) / c_p T_4^2\} - 1] \quad (7)$$

Setting $B = \lambda_f (\Delta t + \alpha + \varepsilon_1 + \varepsilon_2) / c_p T_4^2$ and expanding $\exp B$ into infinite series gives

$$w_{ci} = c_p T_4 \left[B + \frac{B^2}{2} + \frac{B^3}{6} + \dots \right]$$

For very small values of $B \leq 0.04$ one can neglect all higher order terms with accuracy exceeding 98 per cent and Eq. (7) reduces to the simplified equation:

$$w_{ci} = \lambda_f (\Delta t + \alpha + \varepsilon_1 + \varepsilon_2) / T_4 \quad (8)$$

Assuming further that friction losses are negligible, Eq. (8) is then simplified to

$$w_{ci} = \lambda_f (\Delta t + \alpha) / T_4 \quad (9)$$

In actual systems the compressor is not ideal and is usually driven by an electric motor. The electric energy input to the electric motor per unit mass of vapor is given by

$$w_m = w_{ci} / \eta_c \eta_m \quad (10)$$

where η_c is the isentropic compressor efficiency and η_m is the electric motor efficiency.

Equation (10) shows that the electric energy input to the motor driving the compressor depends on the compressor and motor efficiencies. In large systems using centrifugal compressors, the compressor efficiency can be as high as 85 per cent and motor efficiency can be as high as 95 per cent resulting in a combined efficiency of about 80 per cent. However, in very small systems (10-100 kg h⁻¹), the electric motor is usually larger than needed to drive the compressor for operation at steady state. In such situations the motor and compressor efficiencies are much lower resulting in a combined efficiency that can range from 20 to 50 per cent.

3. Effects of Salinity and Temperature on Energy Consumption

Examination of Eq. (9) in Section 2 shows that the work required to compress the vapor consists of two components: $\lambda_f \Delta t / T_4$ and $\lambda_f \alpha / T_4$. The properties of water and saline waters show that as evaporator temperature increases, the latent heat of evaporation decreases, resulting in a lower value of λ_f / T_4 ; however, the value of the boiling point elevation α increases and tends to balance the decrease of the ratio λ_f / T_4 .

Table 1 shows the values of w_{ci} calculated as a function of t_4 for $\Delta t = 0, 1, 2,$ and 4°C assuming a seawater brine salinity of 70 000 p.p.m. The values of α were taken from Fabuss (1980) and the values of λ_f were taken from steam tables (Keyes et al. 1969). It

can be seen here that at $\Delta t = 0$ (infinite heat transfer surface), w_{ci} increases with increasing t_4 . This increase continues until Δt is equal to α , after which the effect of Δt overcomes the effect of α , resulting in the decrease of w_{ci} as t_4 increases.

| | | | | |
|------------------------|--------------|--------------|--------------|---------------|
| t_4 (°C) | 40.00 | 60.00 | 80.00 | 100.00 |
| α (°C) | 0.780 | 0.913 | 1.047 | 1.181 |
| λ_f/T_4 | 7.682 | 7.076 | 6.535 | 6.046 |
| $w_{ci}, \Delta t = 0$ | 5.99 | 6.46 | 6.84 | 7.14 |
| $w_{ci}, \Delta t = 1$ | 13.68 | 13.54 | 13.38 | 13.19 |
| $w_{ci}, \Delta t = 2$ | 21.35 | 20.61 | 19.91 | 19.23 |
| $w_{ci}, \Delta t = 4$ | 36.72 | 34.76 | 32.98 | 31.32 |

Table 1. Isentropic compression work as a function of evaporator temperature with Δt as a parameter and brine at 70 000 p.p.m.

For example, at $t_4 = 100^\circ\text{C}$ and $\Delta t = 4^\circ\text{C}$, the value of $w_{ci} = 31.3 \text{ kJ kg}^{-1}$ while at $t_4 = 50^\circ\text{C}$ and $\Delta t = 4^\circ\text{C}$ the value of $w_{ci} = 35.8 \text{ kJ kg}^{-1}$ an increase of 4.5 kJ kg^{-1} or about 12.3 per cent. This suggests that, as long as $\Delta t > \alpha$, vapor compression systems should be operated at as high temperature as possible to reduce energy consumption. However, this advantage must be balanced against the practical disadvantages of larger heat losses from the system with the corresponding need to add auxiliary heat and increasing corrosion and scaling potentials in the evaporator.

At inland locations where brine disposal may be difficult and expensive, the volume of the brine must be reduced to a minimum requiring the brine to be discharged at as high a salinity as possible. As an example, in a $189 \text{ m}^3 \text{ day}^{-1}$ ($50\,000 \text{ gal day}^{-1}$) vapor compression system (Bechtel National Inc. 1986) used to recover water from agricultural drainage water (about 10 000 p.p.m.) in the San Joaquin Valley, California, the brine was discharged at about 200 000 p.p.m. Data from this plant operating at about 50°C with $\Delta t = 4^\circ\text{C}$ showed that the system can operate without auxiliary heat. The electrical energy consumption by the compressor motor was about 91.3 kJ kg^{-1} (25.4 kWh m^{-3}) resulting in a compressor motor combined efficiency of about 59 per cent.

| | | | | |
|------------------------|-----------|-----------|-----------|------------|
| t_4 (°C) | 40 | 60 | 80 | 100 |
| α (°C) | 2.948 | 3.412 | 3.877 | 4.334 |
| $w_{ci}, \Delta t = 0$ | 22.64 | 24.14 | 25.34 | 26.20 |
| $w_{ci}, \Delta t = 1$ | 30.33 | 31.22 | 31.87 | 32.25 |
| $w_{ci}, \Delta t = 2$ | 38.01 | 38.30 | 38.41 | 38.30 |
| $w_{ci}, \Delta t = 4$ | 53.76 | 52.45 | 51.48 | 50.39 |

Table 2. Isentropic compression work as a function of evaporator temperature with Δt as a parameter and brine at 200 000 p.p.m.

Table 2 shows the calculated values of w_{ci} for the above application as a function of t_4 for $\Delta t = 0, 1, 2,$ and 4°C . They show the effect of increased brine salinity on energy

consumption.

In Table 2 the brine was assumed to have seawater composition with brine discharged at 200 000 p.p.m. It should be noted here that as long as $\Delta t < \alpha$, the value of w_{ci} increased with increasing operating temperature. It is interesting to note that, when $\Delta t = 4^\circ\text{C}$, the energy consumption decreased with increasing temperature. Operating the plant at 100°C and $\Delta t = 4^\circ\text{C}$ results in energy savings of 4.1 per cent in comparison to operating the plant at 60°C and $\Delta t = 4^\circ\text{C}$.

Comparison of the values of w_{ci} from Tables 1 and 2 for $t_4 = 100^\circ\text{C}$ and $\Delta t = 2^\circ\text{C}$ shows that the increase in the brine salinity from 70 000 to 200 000 p.p.m. has doubled the energy required by the compressor due to the large increase in the value of α . This large increase can be reduced significantly by the use of multiple-effect vapor compression distillation instead of single-effect vapor compression distillation as will be shown later in Section 8.

4. System Heat Balance

The heat balance in the system shown in Figure 1 per unit of distillate is given by

$$q_a + w_c = (h_8 - h_1) + (h_6 - h_1)x + q_e + q_{ex} \quad (11)$$

where q_a is the auxiliary heat added to the system.

Rearranging terms and assuming that $t_8 \cong t_6$ and that the specific heat of distillate and brine are equal, Eq. (11) becomes

$$q_a + w_c \cong c_w(1+x)(t_8 - t_1) + q_e + q_{ex} \quad (12)$$

It can be seen here that if w_c is greater than or equal to the right hand side of Eq. (12), no auxiliary heat is needed and the auxiliary heater can be eliminated from the system. However, if w_c is less than the right hand side of Eq. (12), then auxiliary heat is needed to keep the system operating at steady-state. Obviously, the operating temperature in the evaporator has an important influence on heat losses q_e and q_{ex} ; the higher the operating temperature t_5 the larger the heat losses.

Assuming that the evaporator and heat exchanger are well insulated, i.e. q_e and q_{ex} are negligible, Eq. (12) is further simplified to

$$q_a + w_c = c_w(1+x)(t_8 - t_1) \quad (13)$$

Therefore, in order to eliminate the need for an auxiliary heater, the heat exchanger must be sized so that $w_c \geq c_w(1+x)(t_8 - t_1)$. This is important because the majority of mechanical vapor compression systems are powered by electrical energy and auxiliary heat is usually supplied by electric immersion heaters. The elimination of the auxiliary heater will result in lower capital and operating costs. In reality, heat losses are never

negligible. They are a function of the temperature difference between the evaporator and ambient temperatures; the higher this temperature difference, the larger the heat losses. The choice between installing a larger three-stream exchanger or adding an auxiliary electric immersion heater is usually a trade-off between the initial capital cost and electric energy cost. Obviously, if waste heat is available at an appropriate temperature, the electric heater can be replaced by the waste heat and the three-stream heat exchanger can be made smaller to reduce the capital cost. However, another heat exchanger must be added to the system to transfer the waste heat to the feed stream.

As an example, assume a well-insulated vapor compression distillation system operating at the following conditions: seawater feed, $t_5 = 100^\circ\text{C}$, $t_1 = 25^\circ\text{C}$, recovery 50 per cent, and $w_c = 20 \text{ kWh m}^{-3}$. Estimate the highest allowable value of outlet brine and condensate temperatures to eliminate the auxiliary heater.

At these conditions $c_w = 1.16 \text{ Wh kg}^{-1} \text{ }^\circ\text{C}^{-1}$ and $x = 1$. Substituting these values in Eq. (13) gives $t_8 = 33.6^\circ\text{C}$. This is the highest allowable value for outlet condensate and brine temperatures to eliminate the need for auxiliary heat at these ideal conditions.

-
-
-

TO ACCESS ALL THE 34 PAGES OF THIS CHAPTER,
Visit: <http://www.desware.net/DESWARE-SampleAllChapter.aspx>

Bibliography and Suggestions for further study

Akili D. Khawaji, Ibrahim K. Kutubkhanah, Jong-Mihn Wie, (2008), *Advances in seawater desalination technologies*, Desalination **221**, Elsevier, pp. 47-69.

Anonymous (1990) *South Pole Engineering Study. Existing Amundson Scott Station, South Pole, Antarctica*. Prepared by Metcalf and Eddy, Inc. for National Science Foundation, Division of Polar Programs, July.

Bechtel National Inc (1986) *Final Report, Field Test of a Vapor Compression Evaporator at the Demonstration Desalting Facility, Los Banes, California*. Prepared for the State of California, Department of Water Resources, Specification No. 85-31, Contract No. C-50653, San Francisco, California, August 1986.

Bulang W (1983) *Large scale desalination by vapour compression*. Desalination **47**, May.

Chambers J T and Larsen P S (1960) *Series Staging of Vapor Compression Distillation*. Issue No. 20. Sea Water Conversion Laboratory, University of California, Berkeley, California.

Church A M (1945) *Centrifugal Pumps and Blowers*, pp. 208-215. Wiley, New York, NY.

Corrado Sommariva ,(2010),COURSES IN DESALINATION, Thermal Desalination

Disi S A, Stewart J and Goeldner R (1986) *Vapor compression revisited*. (NWSIA Conference, Washington, DC, 8-12 June).

Dodge B F and Eshaya A M (1958) *Economic Evaluation Study of Distillation of Saline Water by Means*

of Forced-circulation Vapor-compression Distillation Equipment, OSW R&D Rep. No. 21, Washington DC.

Fabuss B M (1980) Properties of seawater. *Principles of Desalination*, 2nd ed. (ed. K S Spiegler and A D K Laird), pp. 359-400. Academic Press, New York, NY.

Fosberg T M (1972) *Brine concentration technique for industrial waste water disposal*. (ASME Winter Annual Meeting, New York, 26-30 August).

Fraser J and Heist J (1980) *The absorption freezing vapor compression process*. (NWSIA Conference, San Francisco, California, 6-10 July).

Friedman M A et al. (1992) *Gray Water Recycling with a Unique Vapor Compression Distillation (VCD) Design*. SAE technical Paper Series No. 921318, Seattle, Washington, 13-16 July.

Geiringer P L et al. (1964) *First Annual Report, Brackish Water Conversion Demonstration Plant No. 4, Roswell, New Mexico*. OSW R&D Rep. No. 169, June, Washington DC.

Geiringer P L et al. (1966) *Second Annual Report, Brackish Water Conversion Demonstration Plant No. 4, Roswell, New Mexico*. OSW R&D Rep. No. 170, May, Washington DC.

Genthner K and El-Allawy M M (1983) *Solutions for coupling a mechanical vapour compression distiller with a multi-stage flash evaporator*. *Desalination* 47.

Guide to Further Study

Hancock J F and Sringer W E (1981) *Zero discharge of liquid wastes from power plants*. (NWSIA, Washington, DC, 31 May-4 June).

Hisham El-Dessouky, S. Bingulac, (1995), *A Stage-by-Stage Algorithm for Solving the Steady State Model of Multi-Stage Flash Desalination Plants*, IDA 141, Volume **IV**, pp. 251-27.

Joachim Gebel, Süleyman Yüce, (2008), *A new approach to meet the growing demand of professional training for the operating and management staff of desalination plants*, *Desalination* **220**, Elsevier, pp. 150-164.

Keys K et al. (1969) *Steam Tables*, international edn. Wiley, New York, NY.

M.A. Darwish, Iain McGregor, (2005), *Five days' Intensive Course on - Thermal Desalination Processes Fundamentals and Practice*, MEDRC & Water Research Center Sultan Qaboos University, Oman

M.A. Darwish, Ammar Alsairafi, (2004), *Technical comparison between TVC/MED and MSF*, *Desalination* **170**, Elsevier, pp. 223-239.

M.A. Darwish, Hassan K. Abdulrahim, (2008), *Feed water arrangements in a multi-effect desalting system*, *Desalination* **228**, Elsevier, pp. 30-54.

M.A. Darwish, N. Al-Najem, N. Lior, (2006), *Towards Sustainable Energy in Seawater Desalting in the Gulf Area*, Tenth International Water Technology Conference, Alexandria, Egypt, pp. 655-684.

M.A. Darwish, S. Alotaibi, S. Alfahad, (2008), *On the reduction energy and its cost in Kuwait*, *Desalination* **220**, Elsevier, pp. 483-495.

Martret J (1976) *Desalination through vapor compression process in large plants*. (IDEA Congress, Mexico City, Mexico, 24-29 October).

Miernik J H, Burt H S and McGriff C F (1991) *Waste water processing technology for space station freedom: comparative test data analysis*. (ICES Conference, San Francisco, CA, July).

Mohamed A. Dawoud, (2005), *The role of desalination in augmentation of water supply in GCC countries*, *Desalination* **186**, Elsevier, pp. 187-198.

Mohamed Al-bahou, Zamzam Al-Rakaf, Hassan Zaki, Hisham Ettouney, (2007), *Desalination experience in Kuwait*, *Desalination* **204**, Elsevier, pp. 403-415.

Moyers J C and Senatore S J (1968) *Vapor compressor design studies*. ORNL-TM 2203, UC-80-Reactor Technology, Oak Ridge National Laboratory, Abstracts of Papers. (Water and Desalination Information

Meeting, 7-8 May), Oak Ridge Tennessee.

Murat F and Lucas M (1985) *Desalination by mechanical vapour compression: operational results after one year operation of the Flamanville Unit - comparison with other desalination processes by evaporation*. (IDA Congress, Bermuda, 17-22 November).

Nabil M. Abdel-Jabbar, Hazim Mohamed Qiblawey, Farouq S. Mjalli, Hisham Ettouney, (2007), *Simulation of large capacity MSF brine circulation plants*, *Desalination* **204**, Elsevier, pp. 501-514.

Noble L D et al. (1991a) *An assessment of the readiness of vapor compression distillation for spacecraft wastewater processing*. (ICES Conference, San Francisco, CA, July).

Noble L D et al. (1991b) *Phase change water recovery for the space station freedom and future exploration missions*. (ICES, San Francisco, CA, July).

Ohlemann B, Homburg D and Emmermann D K (1983) *Operating experience and performance data of an advanced VTE/VC seawater desalination plant*. *Desalination* 47.

Reveley W F and Nuccio P P (1975) *Design and the parametric testing of the space station prototype integrated vapor compression distillation water recovery module*. (ICES, San Francisco, CA, July).

Reynolds W C (1968) *Thermodynamics*, 2nd edn, pp. 218-219. McGraw Hill, New York, NY.

Roberton Borsani, Silvio Rebagliati (2005), *Fundamentals and costing of MSF desalination plants and comparison with other technologies*, *Desalination* **182**, Elsevier, pp. 29-37.

Semiati, R., 2000. *Desalination – present and Future*. *Water International*, 25(1), 54-65.

Senatore S J (1968) *Design of gas-turbine vapor compression systems*. ORNL-TM-2203, UC-80-Reactor Technology, Oak Ridge National Laboratory. (Water and Desalination Information Meeting, 7-8 May), Oak Ridge, Tennessee.

Senatore S J (1981) *Vapor compression distillation combined with waste heat utilization*. (NWSIA Conference, Washington, DC, 31 May-4 June).

Senatore S J (1983) *Desalting water costs using waste heat from power systems combined with the VTFE and vapor compression*. *Desalination* 47.

Senatore S J and Tomalin J G (1968) *Gas-turbine and diesel driven vapor compression desalination plants*. (Western Water and Power Symposium Proceedings, Los Angeles, CA, 8-9 April), p. c-33.

Spiegler, K.S. and El-Sayed, Y.M., 1994. *A Desalination Primer*. Balaban desalination Publications, Santa Maria Imbaro, Italy.

Sutorbilt Rotary Positive Blowers (1989) Bulletin S-60, Quincy, Illinois, USA.

Tleimat B et al. (1992) *The use of vapor compression distillation for recycling gray water as an analog application in the antarctic planetary analog*. *Desalination* 87, 97-107.

Tleimat B W (1969) *Novel Approach to Desalination by Vapor Compression Distillation*. ASME Publication No. 69-WA/PID-1.

Tleimat B W (1971) *Performance of a Rotating Flat-disk Wiped-film Evaporator*. ASME Publication No. 71-HT-37.

Tleimat B W (1977) *Design of a small capacity vapor-compression seawater desalination plant utilizing multiple-effect novel wiped-film rotating disk evaporators*. (Arab Physical Society Conference on the Physics of Solar Energy, Benghazi, Libya, October 29 1976).

Tleimat B W (1978) *Design of a small capacity vapor-compression seawater desalination plant utilizing multiple-effect novel wiped-film rotating-disk evaporators*. National Water Supply Improvement Association 5(2), 7-20.

Tleimat B W and Laird A D K (1978) *A 600-hour Test of the Wiped-film Rotating Disk Evaporator with Seawater Feed from the San Francisco Bay*, Rep. for Civil Engineering Laboratory, Naval Construction Battalion Center, Port Hueneme, California.

Tleimat B W and Laird A D K (1987a) *Analysis of and results from the 50,000 gallons per day vapor*

compression evaporator at the demonstration test facility, Los Banos, California. Prepared for the California Department of Water Resources; University of California, Richmond, California, UC/DWR Agreement B55037.

Tleimat B W and Laird A D K (1987b) *Analysis of and Results from the 50,000 Gallons per Day Vapor Compression Plant.* Rep. to California Department of Water Resources, University of California, Richmond, California.

Tleimat B W and Tleimat M C (1989) *A novel 2500 GPD 5-effects wiped-film rotating-disk vapor-compression module; preliminary results.* Desalination 74, 289-303.

Tleimat B W and Tleimat M C (1991) *Antarctic Testbed For Lunar/Mars Outpost Technology Development Vapor Compression Distillation (VCD).* Final Rep. submitted to Lockheed Missiles and Space Company, Inc., Sunnyvale, California, October.

Tleimat B W and Tleimat M C (1995) *Reduced energy consumption evaporator for use in desalting impaired waters and reducing the volume of reject brine.* (IDA World Congress on Desalination and Water Sciences, Abu Dhabi, UAE, 18-24 November).

Tleimat B W and Tleimat M C (1995) *Reduced Energy Consumption Evaporator for Use in Desalting Impaired Waters.* Technical Completion Rep. for the US Bureau of Reclamation, Denver, Colorado.

Tleimat B W and Tleimat M C (19xx) *Design Modification of the Wiped-film Rotating-disk Evaporator for the Reclamation of Water at Zero Gravity.* Final Rep. to NASA Ames Research Center, National Aeronautics and Space Administration, Moffet Field, California.

Tleimat B W, Howe E D and Laird A D K (1967) *Assessment of vapor compression distillation.* Desalination, 287-298.

Tleimat B W, Howe E D and Laird A D K (1967a) *Assessment of vapor compression distillation.* Desalination 2, 287-298.

Tleimat B W, Howe E D and Laird A D K (1977) *Solar-assisted still with vapor-compression option.* Desalination 22, 41-54.

Tleimat B W, Laird A D K and Howe E D (1967b) *Vapor Compression Distillation. Part I.* Sea Water Conversion Laboratory Rep. No. 67-3, Water Resources Center Rep. No. 18, University of California, Richmond, California.

Tleimat B W, Laird A D K and Howe E D (1985a) *Simulation of Multiple Effect Vapor Compression.* Quarterly Rep. to the California Department of Water Resources for UC/DWR Agreement B-55037, University of California, Richmond, California.

Tleimat B W, Laird A D K and Howe E D (1985b) *Vapor-compression distillation, multieffect vapor-compression distillation, and multieffect distillation.* (Seminar presented at the Department of Water Resources, State of California, Fresno, CA, 17 September).

Willenbrock A Jr et al. (1964) *Thin Film Vapor Compression Saline Water Conversion System.* OSW R&D Rep. No. 85, February, Washington DC.

Y.M. El-Sayed, (2001), *Designing desalination systems for higher productivity*, Desalination **134**, Elsevier, pp. 129-158

Zdankiewicz E M and Schubert F H (1984) *Development of an Advanced Preprototype Vapor Compression Distillation Subsystem (VCDS) for Water Recovery.* Final Rep. to NASA.

Zdankiewicz E M and Price D F (1985) *Phase change water processing for space station.* (Fifteenth ICES, San Francisco, CA, July).